


EM=421

LCMS Scan ESI+

Ret. Time: 0.74 <<<< POSITIVE SPECTRA >>>>

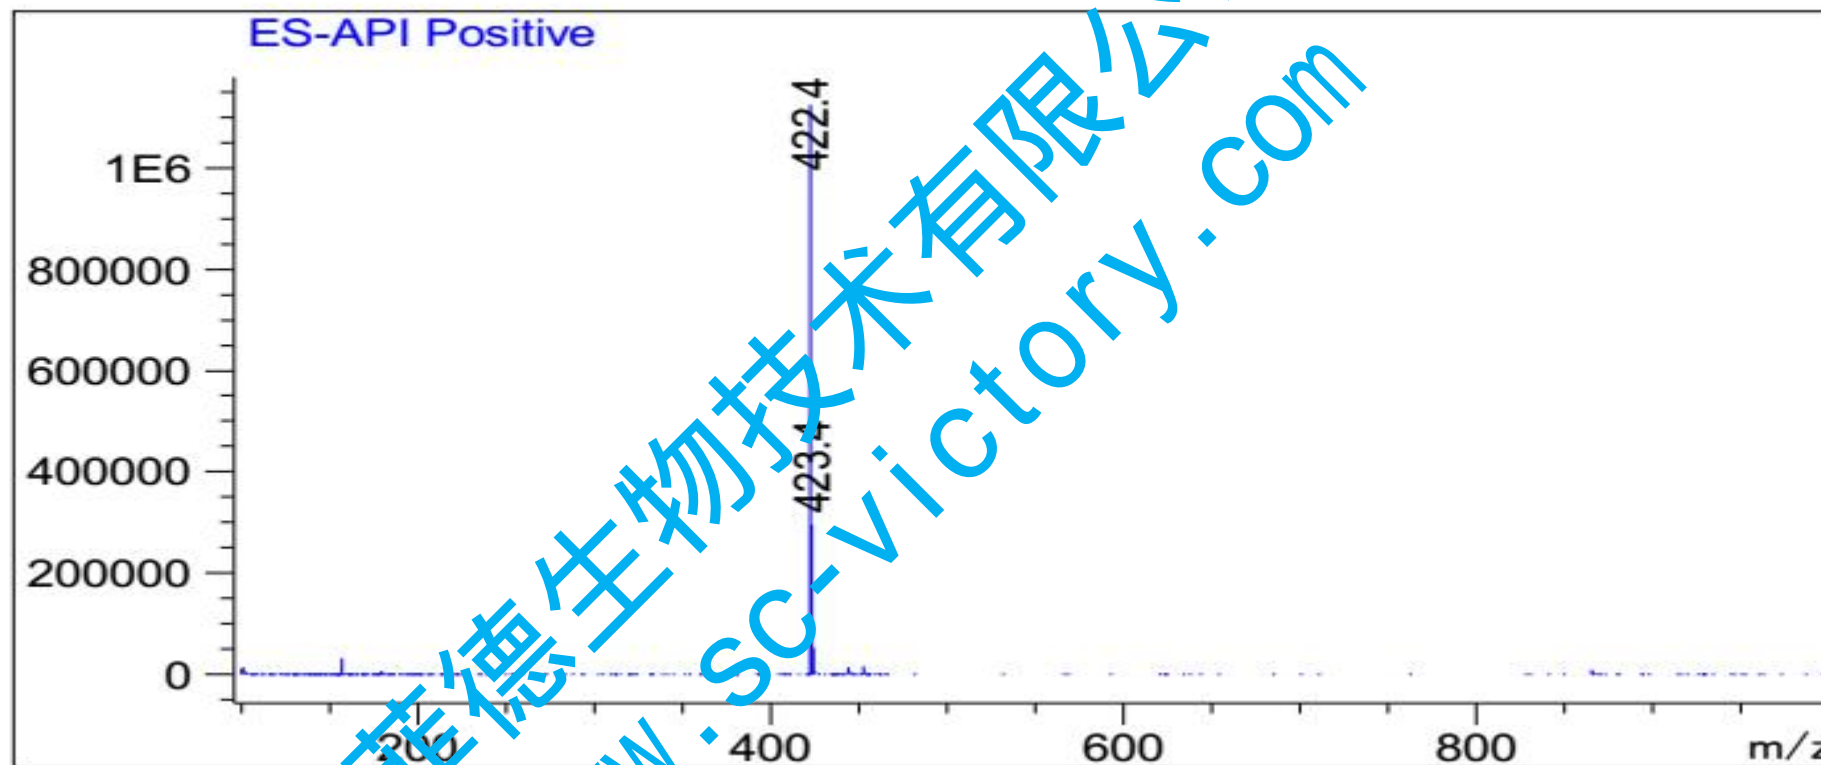

成都普菲德生物技术有限公司
http://www.sc-victory.com